


## General

V 1.2

T-300A-3V series is one of world lowest and smallest dimension CO<sub>2</sub> sensor miniature. Its consistent stability with easy management are much favored by customers in residential buildings, offices, cabin of vehicles, or so.

---

# ELT Sensor Data Sheet for T-300A-3V

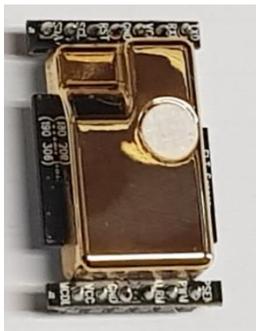

## Features

- Non-Dispersive Infrared (NDIR) technology used to measure CO<sub>2</sub> levels.
- World's lowest height and small dimension miniature sensor.
- Available output : TTL-UART, I2C, PWM
- Gold-plated sensor provides long-term calibration stability.
- Calibration functions : ACDL (Periodical Automatic Calibration) is default.
- Size : 19mm x 31mm x 8.2mm (W,L,H)
- Weight : 5 grams

## T-300A-3V Specifications

### General Performance

**Operating Temperature** : -10°C ~ 60°C

**Operating Humidity** : 0 ~ 95% RH (Non-condensing)

**Operating Environment** : Residential, Commercial spaces

**Storage Temperature** : -30°C~70°C

### CO<sub>2</sub> Measurement

**Sensing Method** : NDIR (Non-dispersive Infrared)

**Measurement Range** : 400 ~ 5,000 ppm (400~2,000,3000,10,000ppm can be chosen as option)

**Accuracy** : ± 25ppm ± 5%of reading <sup>(1)(2)</sup>

**Response Time(1/e)** : 40 seconds (c.f. T<sub>90</sub> : 60 seconds)

**Signal Update** : 5 seconds


**Warming-up Time** : < 10 seconds (for Operation), < 5 minutes (for Accuracy)

### Electrical Data

**Power Input** : 3.3VDC (3.2~3.5V)<sup>(3)</sup>

**Current Consumption**: I<sub>normal</sub> < 8mA, I<sub>peak</sub> < 200 mA

### Pin-Map of J1 : Left Side-holes.

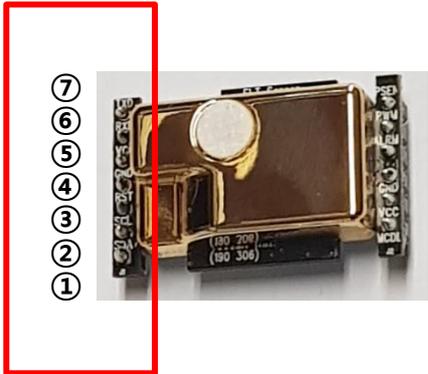
Pin No.	T-300A-3V	J1 : Left side hole
1	I2C SDA	
2	I2C SCL	
3	/Reset	
4	GND	
5	VCC	
6	TTL-RXD( ← CPU of Master Board )	
7	TTL-TXD( → CPU of Master Board )	

<sup>(1)</sup> Maintenance-free for normal indoor application with ELT Automatic calibration.

<sup>(2)</sup> +/- 1% is added for absolute measurements for uncertainty of calibration gas mixture unless the measurement is done with certified calibration mixtures.

<sup>(3)</sup> DC Supply should be regulated, low noise power source for best accuracy.,

**Pin-Map of J2 : Right Side-holes.**

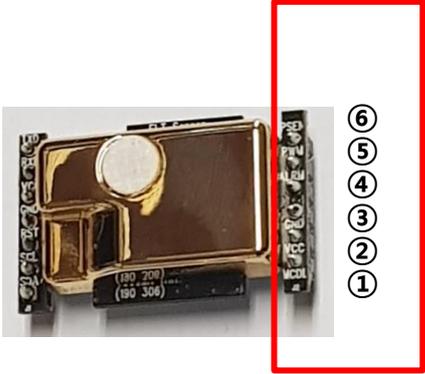Pin No.	T-300A-3V	J2 : Right Side-holes
1	MCDL (10 min. Manual Calibration)	
2	VCC (+3.3V)	
3	GND	
4	Alarm (3.3V/0V switching)	
5	PWM	
6	Reserved (/PSEN)	

Digital I/O Level Voltage :  $0 \leq V_{IL} \leq 0.5$ ,  $2.0 \leq V_{IH} \leq V_{DD}$ ,  $0 \leq V_{OL} \leq 0.6$ ,  $2.7 \leq V_{OH} \leq V_{DD}$  (Volt)

**UART**

38,400BPS, 8bit, No parity, 1 stop bit, TTL Level Voltage

**I2C**

Slave mode only, Pull up resistor is needed on Main-board.


**PWM Output : Option.**


$$t_H = 2 \text{ msec(Start)} + 1,000 \text{ msec} \times (\text{Measurement}_{(\text{ppm})} / \text{Range}_{(\text{ppm})}),$$

$$t_L = 2,000 \text{ ppm} - t_H, (\text{Period} : 2,000 \text{ ppm})$$

**Alarm :** Optional (Protection Circuit to prevent from sensor to main-board is essential.)


1200 ppm ≤ On (High), 800 ppm ≥ Off (Low)

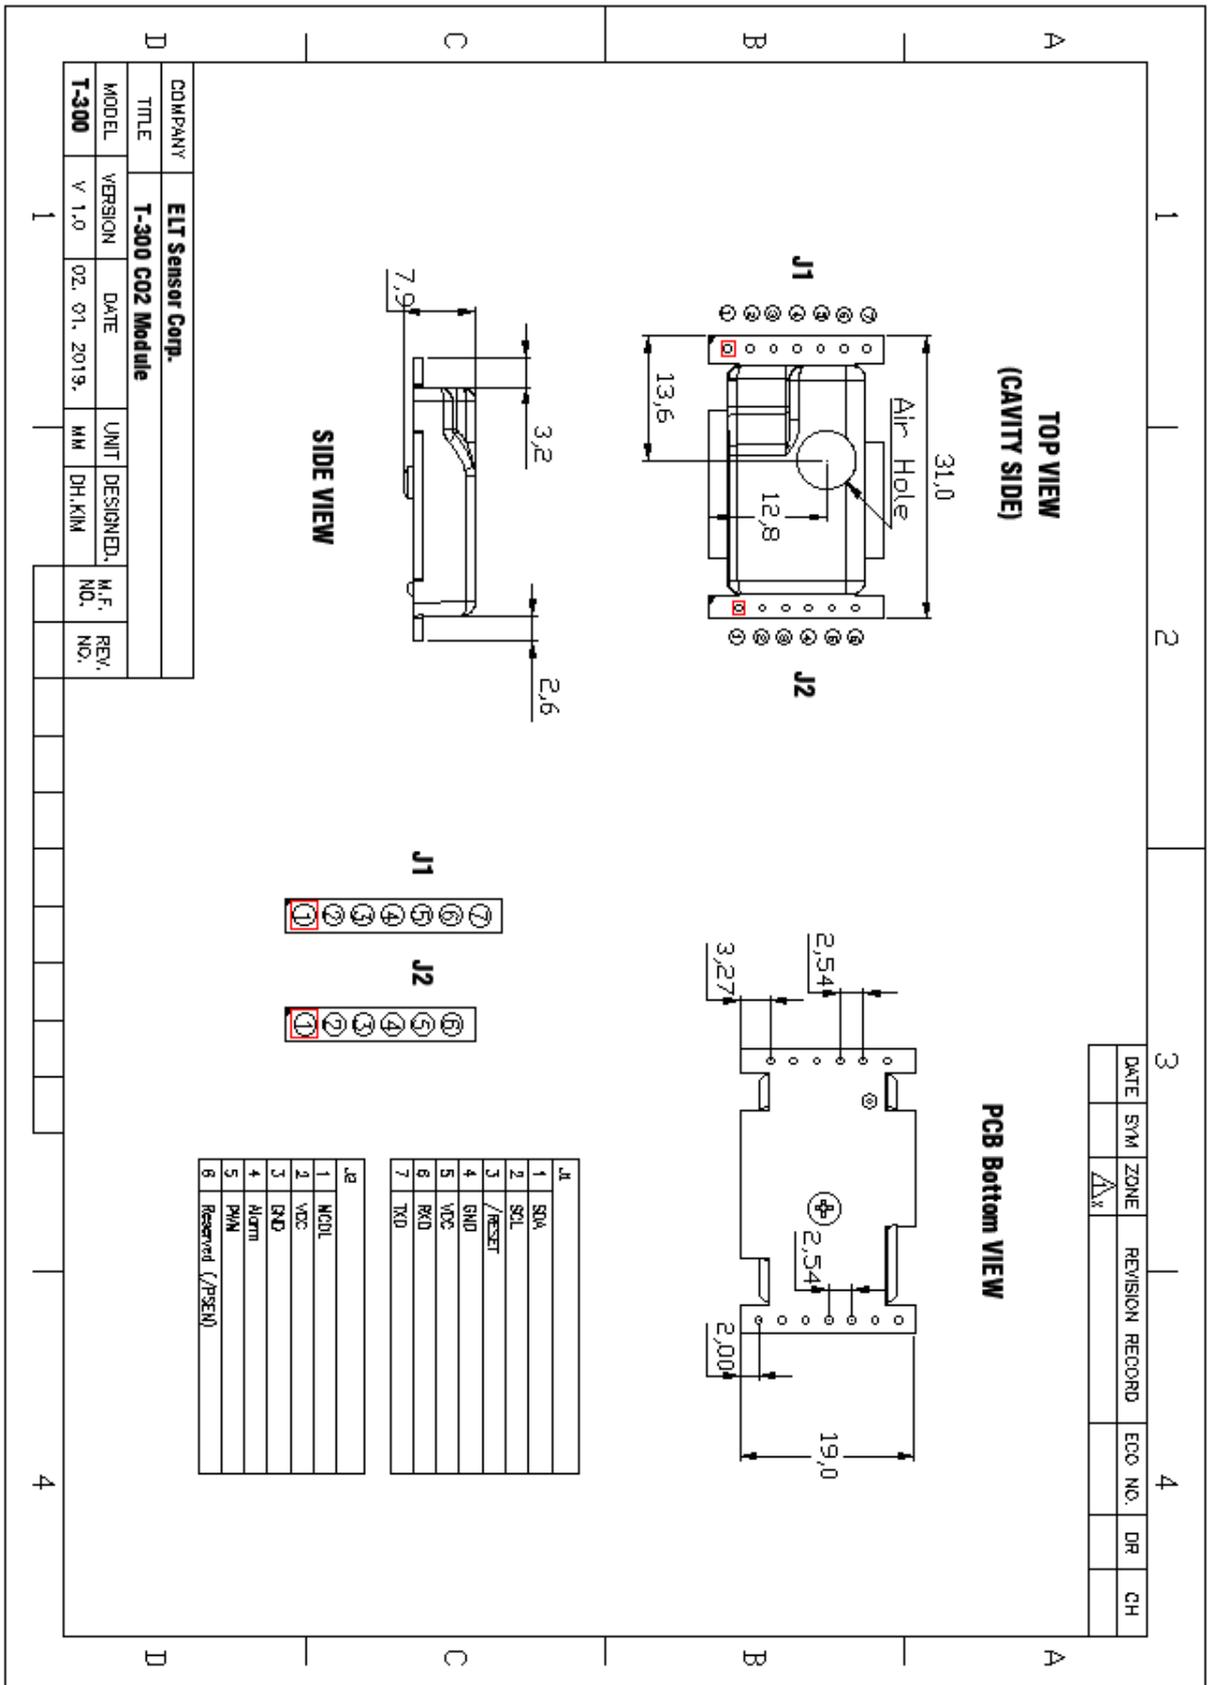

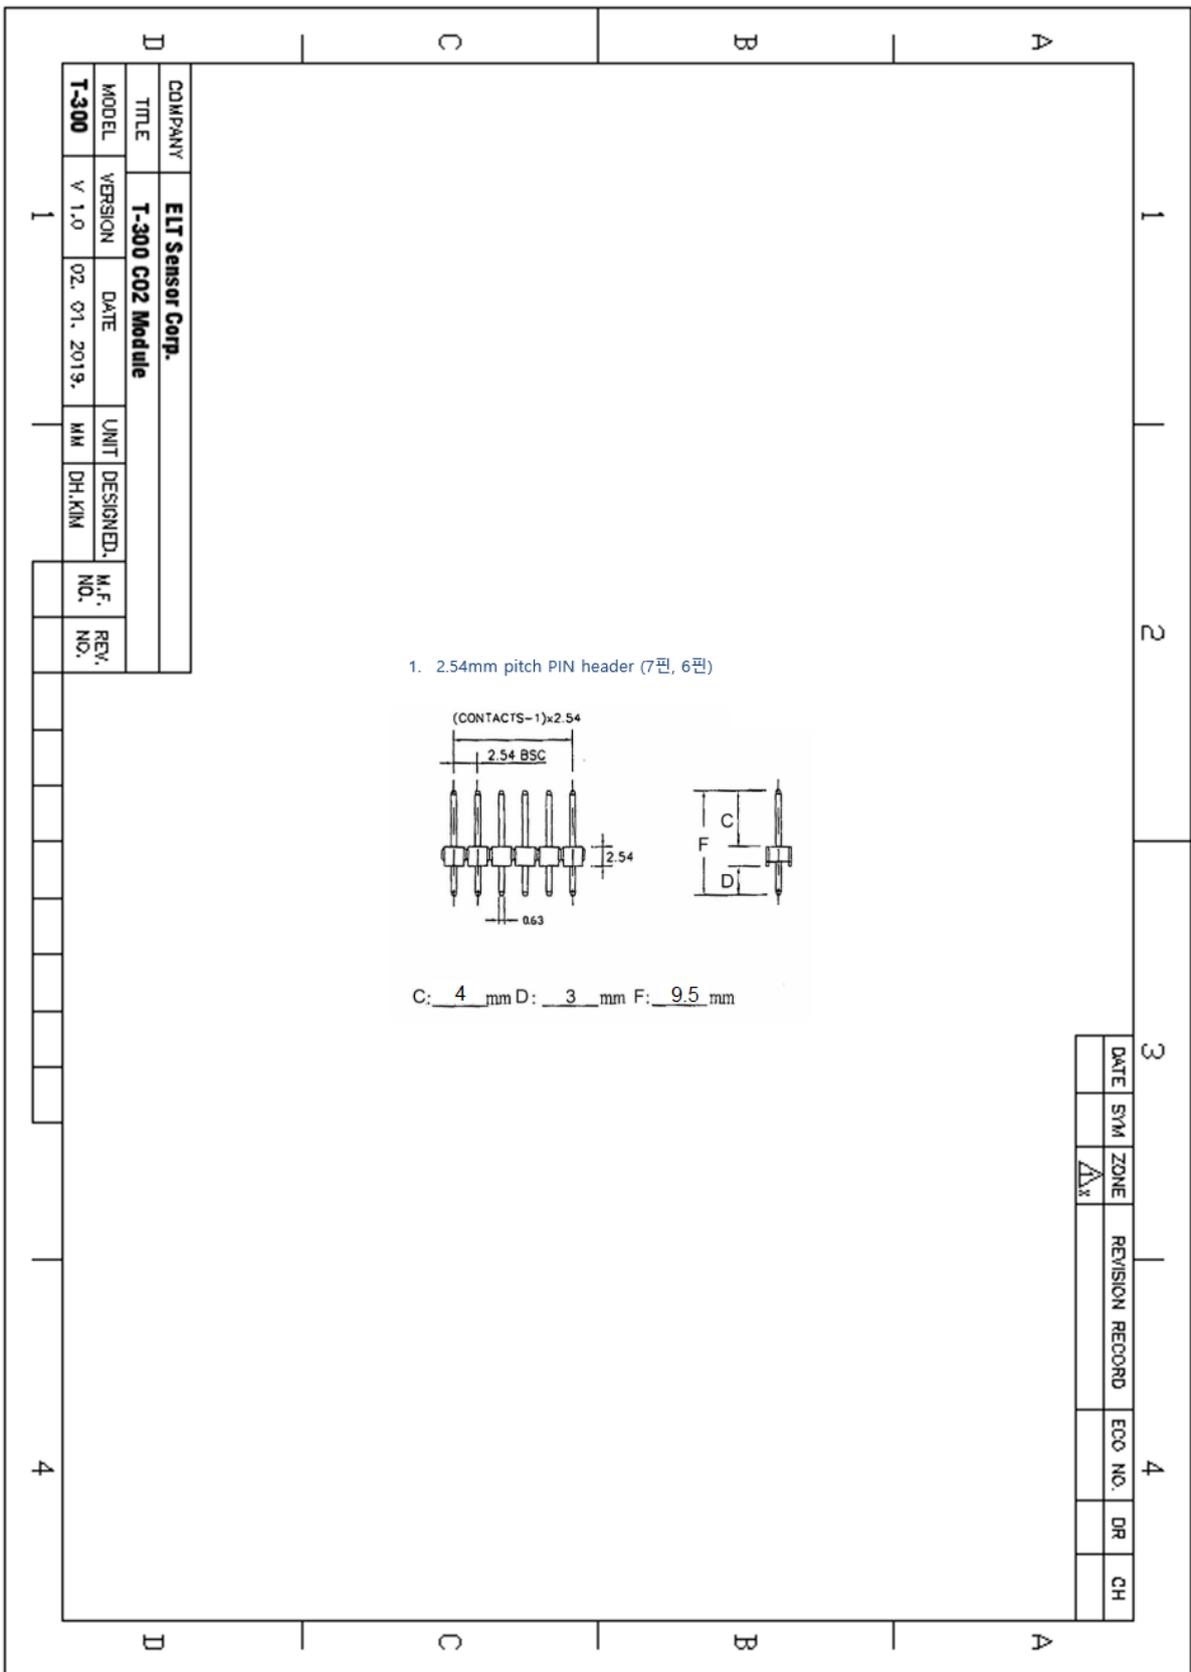

### ACDL mode (Automatic Calibration Mode in dimming light with period)

; start as default when powered on. T-300A-3V always operate as ACDL unless MCDL is activated.

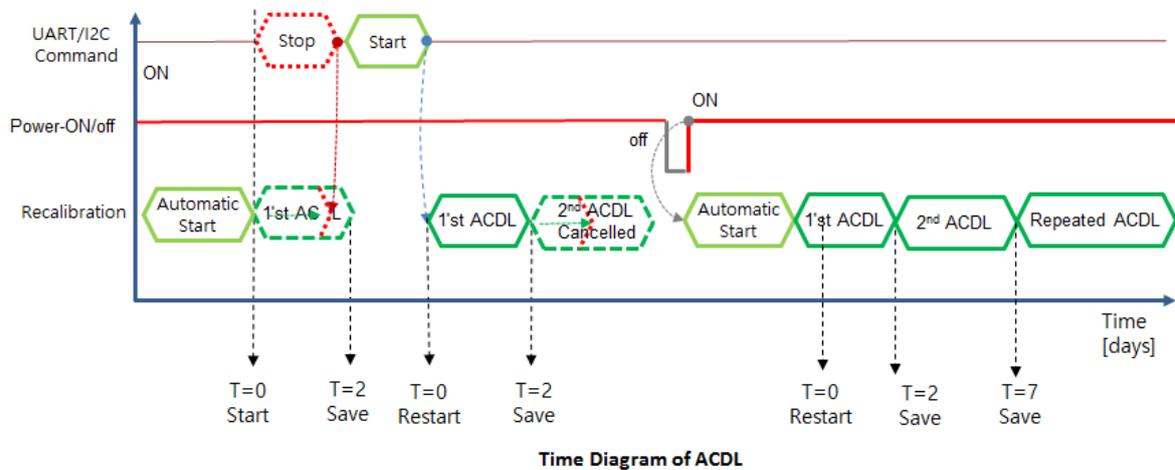


Method 1. UART Command Set; J1-6pin (UART-RX) & J1-7pin (UART-TX) to Main-Board.

Method 2. I2C Command Set; J1-1pin (SDA) and J1-2pin (SCL) to Main-Board.

### MCDL mode (10 minute Manual Calibration mode in dimming light)

MCDL enable customer to calibrate as needed, MCDL keep at least 10 minute once it start and should be stopped before 18minutes to avoid MCDL fetch repetition.

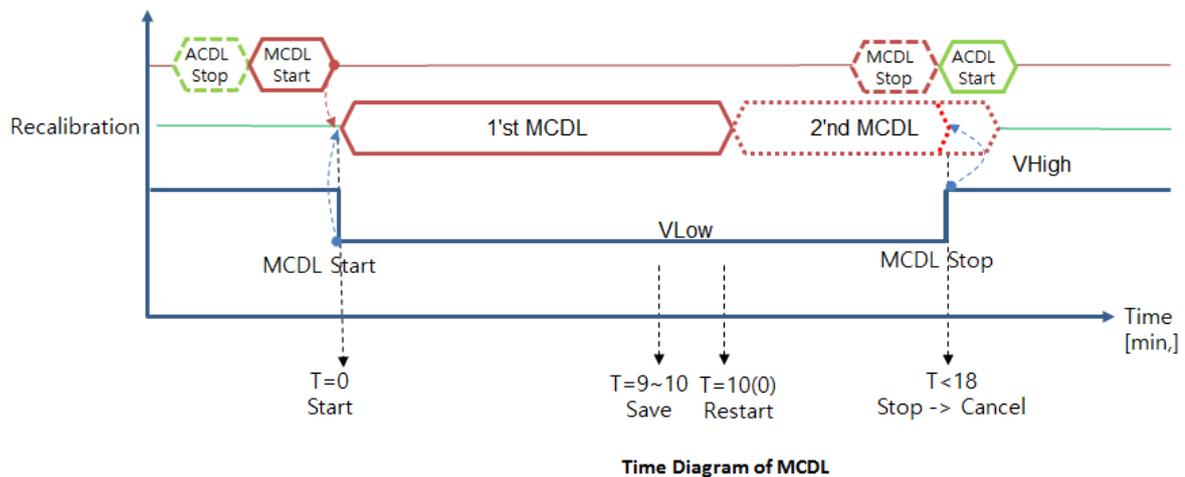

Method 1. UART Command Set; J1-6pin (UART-RX) and J1-7pin (UART-TX) to Main-Board.

Method 2. I2C Command Set; J1-1pin (SDA) and J1-2pin (SCL) to Main-Board.

Method 3. MCDL Control-pin is available.

## Output Descriptions

### UART Descriptions

Data Format

D6	D5	D4	D3	D2	D1	SP	'p'	'p'	'm'	CR	LF
----	----	----	----	----	----	----	-----	-----	-----	----	----

D6 ~ D1	6 byte CO2 density string
SP	Space: 0x20
'ppm'	'ppm' string
CR	Carriage return : 0x0D
LF	Line feed : 0x0A

Above 12byte consist by 6 byte hexadecimal digits,<SP>,0x70 0x70 0x6D, <CR><LF> , where decimal '0' (corresponds to hexadecimal digit '0x30') is replaced by space (corresponds to hexadecimal digit '0x20'),

EX) 1,255 ppm, results '0x20 0x20 0x31 0x32 0x35 0x35 0x20 0x70 0x70 0x6D 0x0D 0x0A', which displays '\_1255\_ppm<CR><LF>'on screen.

In need of detail command set, 'U-ART String Command Guide ' could be provided by contacting Sales Rep.

### I2C Communication (Only Slave Mode Operation)

Internal pull up resistor


Slave Address: 0x31, Slave Address Byte: Slave Address(0x31) 7 Bit + R/W 1 Bit

Bit7	Bit6	Bit5	Bit4	Bit3	Bit2	Bit1	Bit0
0	1	1	0	0	0	1	R/W Bit

R/W Bit : Read = 1/Write = 0

When reading the data, Slave Address Byte is 0x63, When writing the data, Slave Address Byte is 0x62.


**Block Diagram**

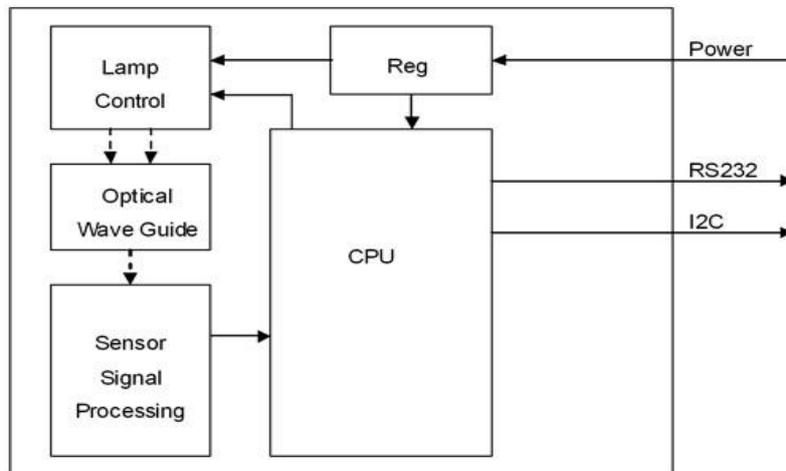

**Transmission Sequence in Master**

- 1) I2C Start Condition
- 2) Write Command(Slave Address + R/W Bit(0) = 0x62) Transmission and Check Acknowledge
- 3) Write Command(ASCII 'R' : 0x52) Transmission and Check Acknowledge
- 4) I2C Stop Command
- 5) I2C Start Command
- 6) Read Command(Slave Address + R/W Bit(1) = 0x63) Transmission and Check Acknowledge
- 7) Read 7 Byte Receiving Data from Module and Send Acknowledge  
(Delay at least 1ms for reading each byte)

Configuration	CO <sub>2</sub>	reserved	reserved	reserved	reserved
1 Byte	2 Byte	0x00	0x00	0x00	0x00

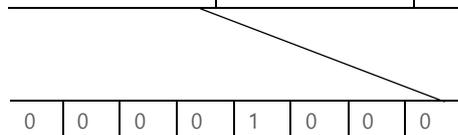


In need of detail protocol specification and time sequence, 'I2C programming guide' could be provided by contacting Sales Rep.

**PWM Descriptions (Option)**

\* Measurement<sub>(ppm)</sub> = (t<sub>H</sub>-2msec)/1000msec x Range<sub>(ppm)</sub> (t<sub>H</sub> : High Pulse Width)

\* Range<sub>(ppm)</sub> : 0~2,000 (0~5,000ppm is option)

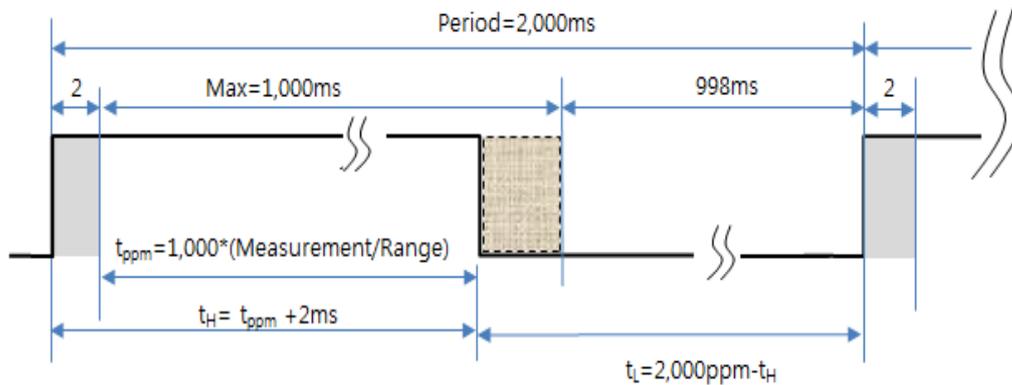

EX)  $t_H$ (High Pulse Width) calculation for 400ppm in 2,000 ppm Range.

\* $Measurement_{(ppm)} = 400 \text{ ppm} = (t_H - 2ms) / 2,000msec \times Range_{(ppm)}$  ,

\* $t_H = 1,000 \text{ msec} * (400 \text{ ppm} / 2,000ppm) + 2msec = 202msec$

(cf:  $T_L = \text{Period} - t_H = 2,000ppm - 202 \text{ msec} = 1,798 \text{ msec.}$ )

**※ Caution**

1. Please hold only 'PCB' of sensor without holding Cavity directly to avoid the physical shock on sensor. Rough handling or Transportation could result in inaccurate reading.
2. Proper ESD protection during handling is important to avoid electrostatic defect occurrence. The storage of sensor should be insulated as well



ChunuiTechnopark 101-910) 36,  
 Bucheon-ro 198beon-gil, 2015  
 Wonmi-gu, Bucheon-si, Gyeonggi-do, 420-857, Korea  
 Phone. +82-32-719-8055, <http://www.eltensor.co.kr>

Subject to change without notice. Printed in KOREA  
 ELT Sensor All rights reserved.  
 2019. March